



# Meter Clearance Requirements

**A**

THESE GUIDELINES REFLECT INTEGRYS STANDARDS 610.2.4.

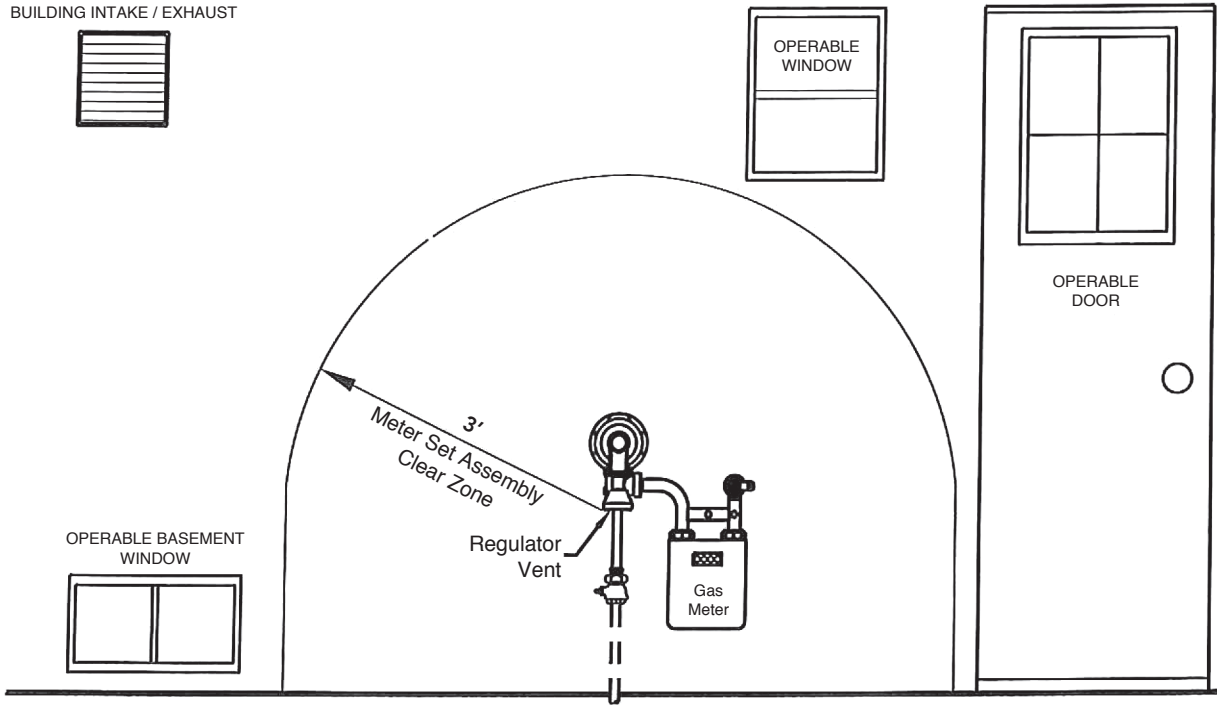

**B**

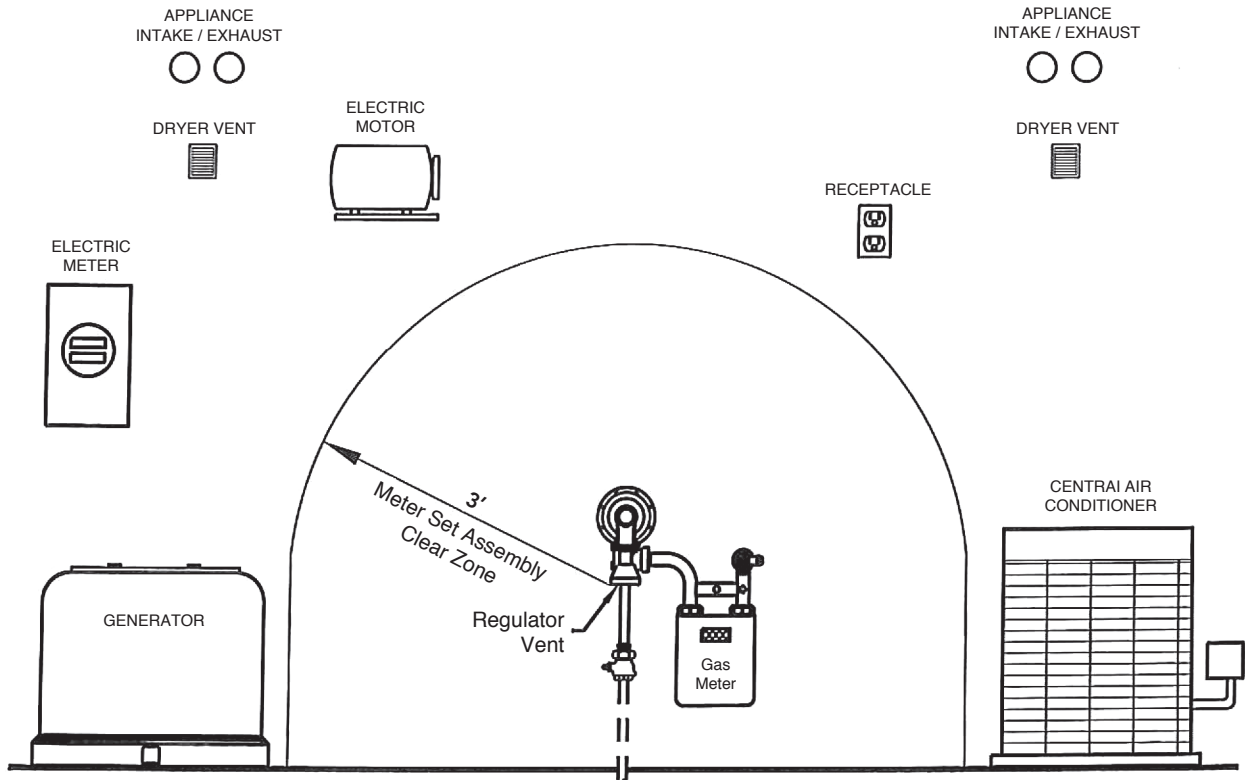

NOTE: 3 FOOT CLEARANCE REQUIRED IN FRONT OF METER FOR SAFETY AND ACCESS.